

PREPARING FOR INSIDE STORE SALES

PAPERWORK

A site plan is available indicating the correct address and showing the location of the fireworks display.

Inventory records are available for review.

SIGNAGE

No Smoking signs are posted and visible.

Signs are posted to indicate that a person *Must be 18 Years of Age to Purchase Fireworks*.

FIRE EXTINGUISHERS

A properly serviced 10 lb. multi-purpose type ABC dry chemical fire extinguisher (4A:40B:C rated) AND a 2½ gallon pressurized water extinguisher (2A rated) is located on site.

SITE LOCATION

Fireworks are not located at check-out isles.

Fireworks are stored in the same location as listed on the permit application.

Fireworks displays are not located within 5' of a store entrance.


OPERATIONS

The fireworks display is visually supervised while the store is open.

Only packaged fireworks are displayed for sale.

Sales displays do not exceed 6' in height and combustibles are stored above the display.

Exits are marked and easily accessible.

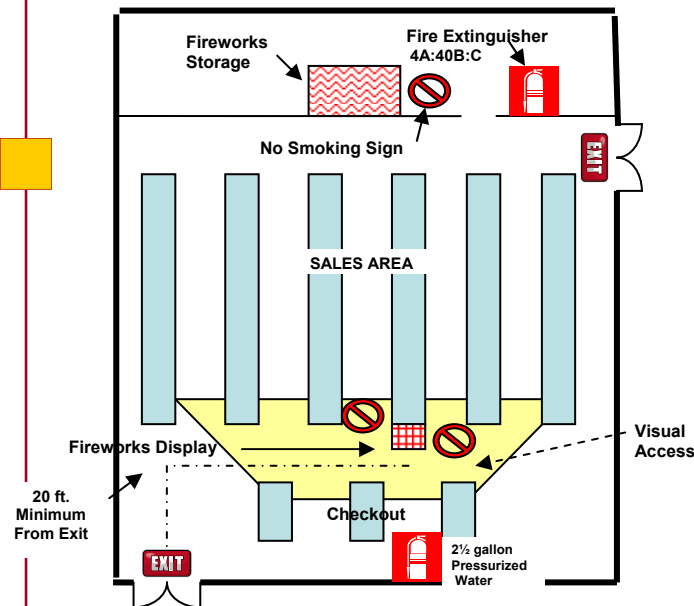

Preparing Your Retail Fireworks Display

This brochure is provided as a tool to ensure retail fireworks sales tents and stands operate in accordance with National Fire Protection Association (NFPA) Code 1124

**Gwinnett County
Office of the Fire Marshal**
446 West Crogan Street, Suite 100
Lawrenceville, GA 30044
678-518-6100 • 678-518-6101 Fax
www.gcfmo.com or www.gwinnettfiremarshal.com

**Gwinnett County
Office of the Fire Marshal**

PREPARING FOR OUTSIDE TENT AND STAND SALES

PAPERWORK

- A site plan is available indicating the correct address and showing the location of the tent/stand on the site.
- The tent/stand size is the same as what is listed on the permit.
- Paperwork is available indicating the hours of operation and indicating how the fireworks will be secured after hours.
- A flame spread certificate is available for the tent or canopy.


SIGNAGE

- EXIT signs are posted at all exits.
- Signs are posted on the exterior of each side of the tent or stand to indicate *No Fireworks Discharge within 300 feet*.
- No Smoking* signs are visibly posted at the entrance to the tent or stand.
- Signs are posted at the cash register to indicate that a person *Must be 18 Years of Age to Purchase Fireworks*.


FIRE EXTINGUISHERS

- A properly serviced 10 lb. multi-purpose type ABC dry chemical fire extinguisher (4A:40B:C rated) AND a 2½ gallon pressurized water extinguisher (2A rated) is located on site.

Typical Fireworks Tent

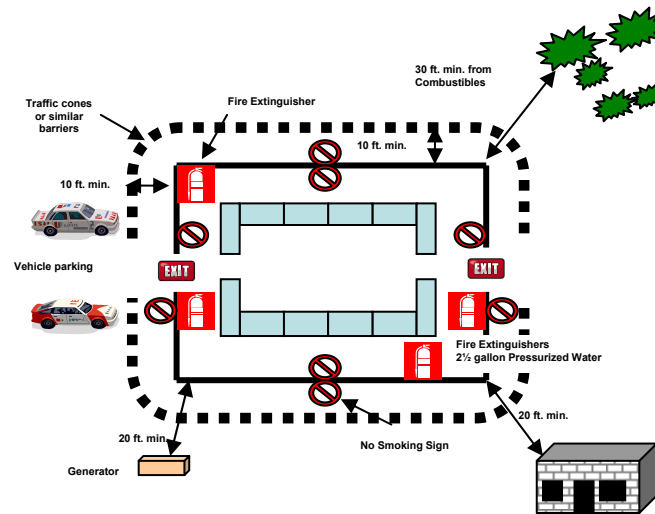

Typical Fireworks Stand

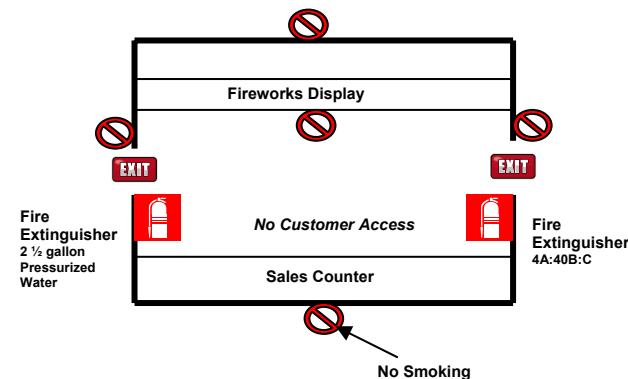

SITE LOCATION

- If the tent/stand is set-up in a grassy field, the area was cleared of weeds and debris before set-up.
- The tent/stand placement matches the submitted site diagram.
- The tent/stand is located
 - 10' away from vehicle parking.
 - 20' away from buildings or storage containers.
 - 30' away from combustible materials.
 - 50' away from vehicle fuel dispersing areas.

OPERATIONS

- A minimum of two exits are provided and both are clearly marked.
- Both exits are easily accessible (minimum 44" clearance opening in tents and 32" clear width in stands).
- The fuses of all fireworks in the sales display are covered.
- Sales displays do not exceed 6' in height and no combustible materials are stored above the fireworks display.
- Security is provided for the tent/stand or portable container/building after business hours.
- Generators are located at least 20' away from the tent or stand.
- Generator fuel is stored in an appropriate UL listed fuel container.

The Gwinnett County Office of the Fire Marshal, in pursuant to National Fire Protection Association Code 1124 for the *Manufacture, Transportation, Storage, and Retail Sales of Fireworks and Pyrotechnic Articles* section 7.3, requires a permit for the sale of fireworks at a temporary structure or tent.