




**GWINNETT COUNTY**  
**DEPARTMENT OF WATER RESOURCES**  
**Backflow Prevention**  
*Protecting Water Protecting People*

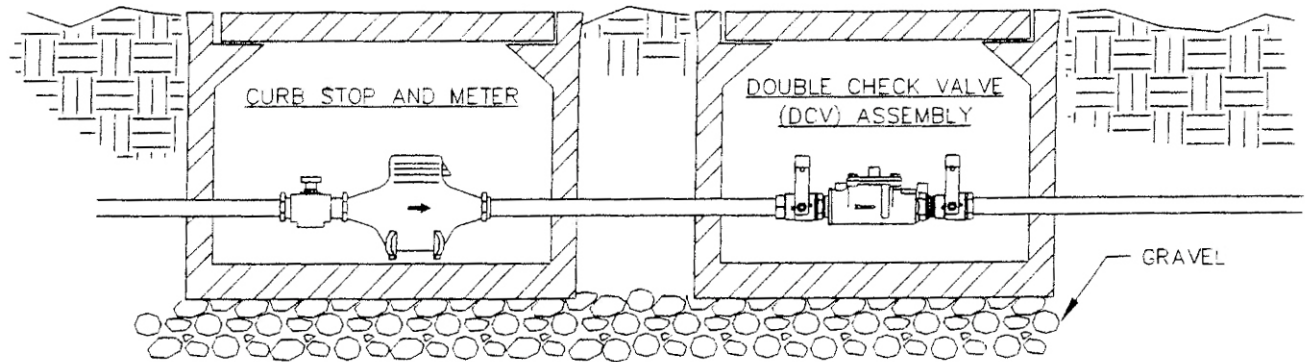

***NOTE:*** For final approval, assembly ***MUST*** be centered in enclosure.

\*No bricks allowed to adjust backflow box to grade.

\*Backflow box must be minimum 24"x18"x12" on 3/4" thru 2" backflow.

\*Any opening on backflow box must be sealed with appropriate material.

\*Unions or swivel nuts must be integral with the device or valve.

If you have any questions, please call Gwinnett County Department of Water Resources Backflow at 678-376-4213.